


| | | | | | | | | | | | | | | |
|-------|---|----------------|---|------|---|--------|---|-----------------|----|----|----|----|----|----|
| 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 | 13 | 14 | 15 |
| Trafo | | Overtemperatur | | Låge | | Blæser | | Temperaturføler | | | | | | |

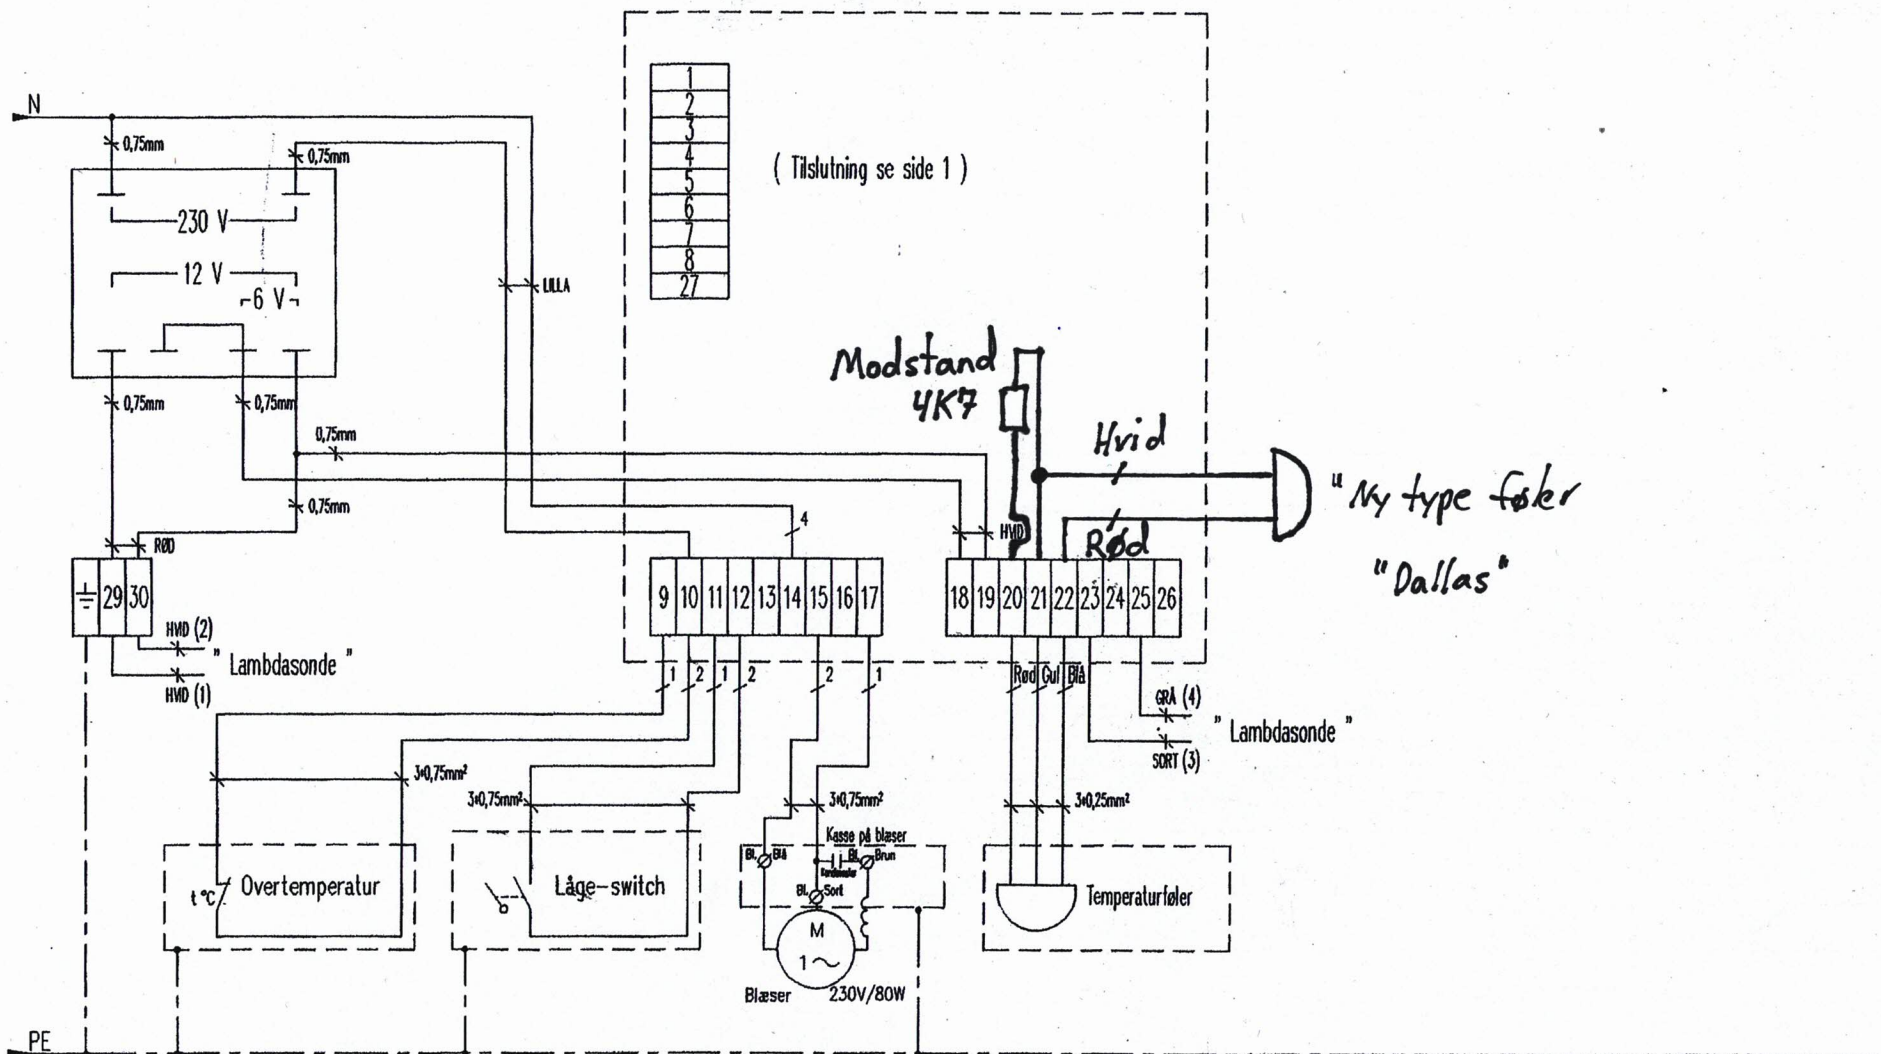

| | | | | |
|-----------------------------|-----------|-------------|------------|------|
| Firma | Dato | Navn | El diagram | Side |
| Pricatech, Tlf. 97 91 15 57 | 22.10.96 | | | |
| Reference | Rev. dato | Diagram nr. | Stoker | 2 |
| KH/TTH | 05.11.01. | PCT 257 ILT | | |